


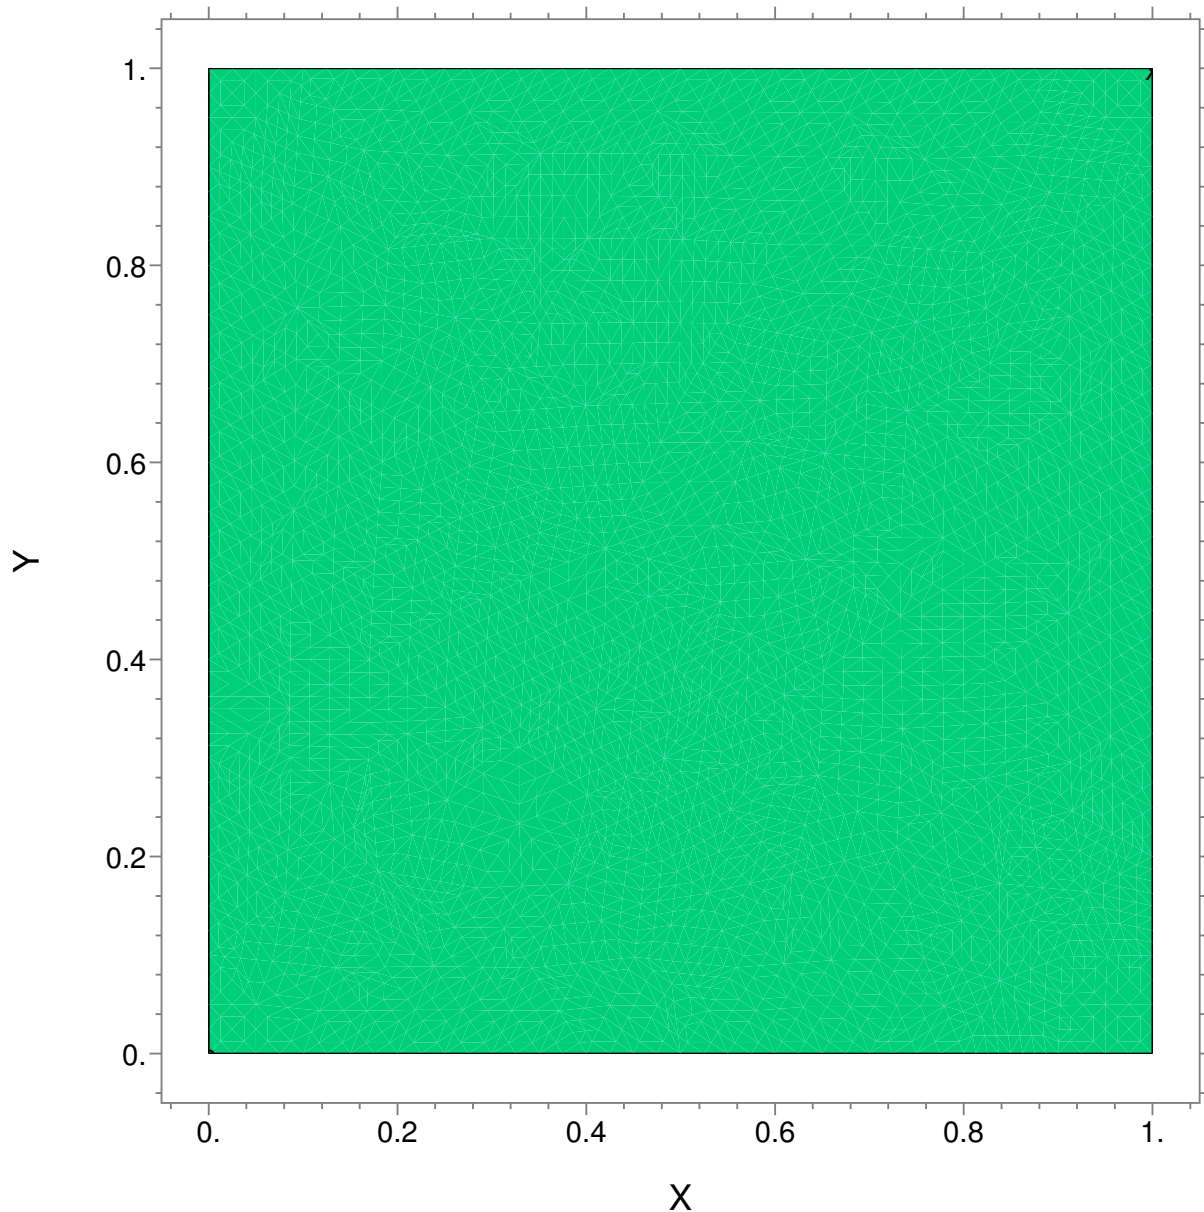

Calculo do campo de temperaturas

max	54.6925
	54.6960
	54.6930
	54.6900
	54.6870
min	54.6925

ExoTermicolsoTeg: Cycle=290 Time= 119.10 dt= 0.5000 P2 Nodes=505 Cells=232 RMS Err= 6.2e-9
Integral= 54.69251